


VISULEX Ex-Camera K06A-Ex

 II 2G Ex de IIC T6 Gb
II 2D Ex tb IIIC T80°C Db

• Description:


The VISULEX Ex-Camera K06A-Ex has been manufactured with a flameproof enclosure ignition protection type 'd' for the body and increased Ex-e safety for the terminal compartment. It is approved for applications in potentially explosive (Ex) areas, zones 1 and 2 as well as zones 21 and 22.

To ensure trouble-free operations, it is essential to observe the temperatures for the built-in camera that are specified in the data sheet. The relevant control panel is connected to the Ex-camera outside the Ex hazardous area. Ex cameras are intended for property surveillance as well as for the remote monitoring of technical processes in reactors, apparatus, vessels, etc. They are purpose-designed and are specifically for mounting on sight glass flange fittings.

Important, please note: Under no circumstances should a camera be used to replace the cover flange or the complete sight glass fitting, nor should it be used on its own as a closure for a vessel port. Cameras for potentially explosive areas should only be mounted, installed and serviced by personnel who have been expressly trained for this work and authorised to do the job in each case.

• General electrical data:

- Feed voltage to the camera: 24 V/DC ± 10%
- Maximum power consumption: 20 W
- Protection class: IP65 acc. to EN 60529/DIN VDE 0470, Part 1
- Ex approval acc. to EC type examination certificate: BVS 08 ATEX E 132

 II 2G Ex de IIC T6 Gb
II 2D Ex tb IIIC T80°C Db

• Markings:

The camera has a permanent type plate which is clearly visible and easy to read. It bears the following data:

- Name and address of manufacturer
- Camera type: K06A-Ex
- Explosion protection classification
- Ambient temperature range: $-20^{\circ}\text{C} \leq T_a \leq +40^{\circ}\text{C}$
- Certificate number
- Warnings which must be observed:
 - Do not open when power is on
 - Even after the power has been switched off, wait four minutes before opening
- Use only heat-resistant cables as specified in the operating instructions
- Serial number/year of manufacture
- Supply voltage
- Protection class: IP65
- CE symbol/certification body number

• Connecting cable:

- Shielded control cable 3P x AWG 20 C, black (Metrofunk) or equivalent cable of another make should be used.
- Heat-resistance: min. -20°C to $+70^{\circ}\text{C}$; flame-inhibiting or flame-retardant!




VISULEX Ex-Camera K06A-Ex with fixed lens

• Electrical connection:

- Open the cover of the terminal box.
- Insert the cable through the entry gland (Ex-e) into the terminal box.
- Wire to Ex terminals (part 5).
- Ensure that the external protective conductor terminal (part 1) is connected to a separate plant earthing point.
- Position the cover seal and close the cover.
- The camera is protected by fuses in the external control unit (located in the non-explosive area).
- These fuses should only be changed after the system has been switched off and only by personnel who have been trained and authorised to do so.

• Changing the camera and/or electronics:

Any replacement of the camera assembly should be carried out by the manufacturer and/or be done at the manufacturer's works (Papenmeier).

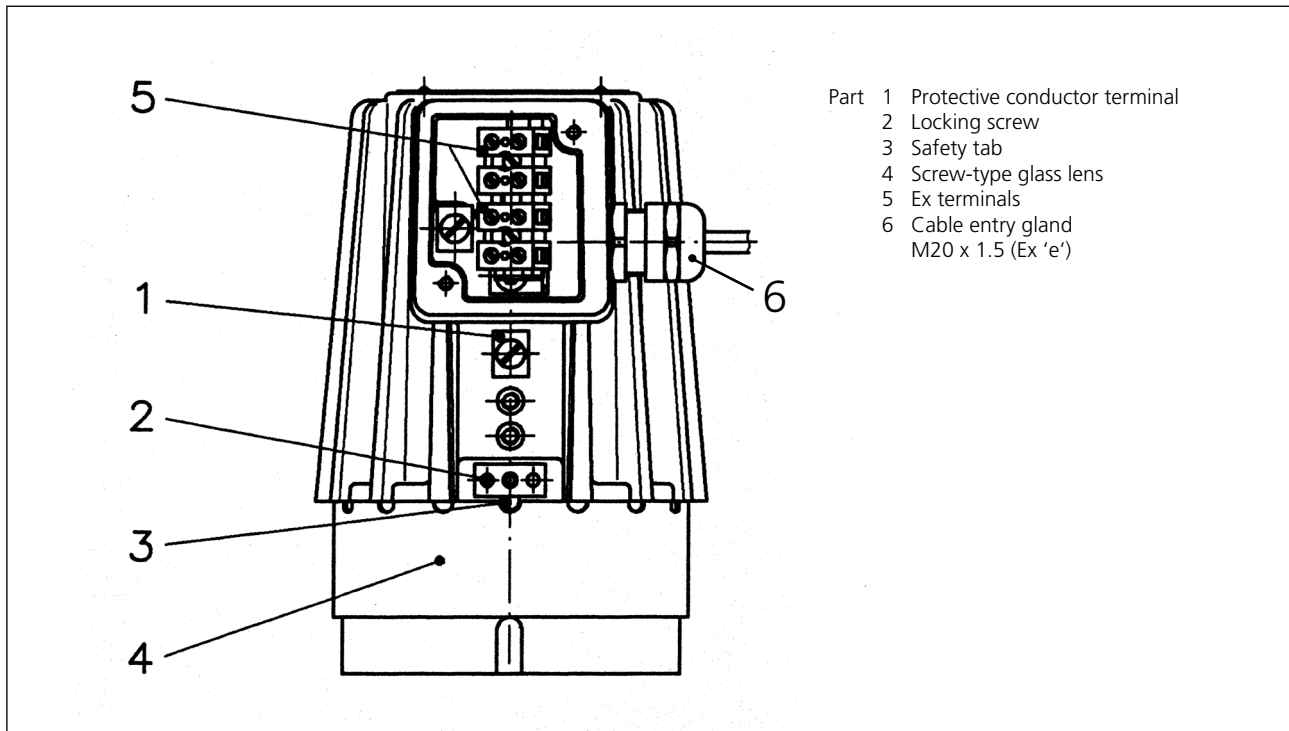

- Part 1 Protective conductor terminal
 2 Locking screw
 3 Safety tab
 4 Screw-type glass lens
 5 Ex terminals
 6 Cable entry gland
 M20 x 1.5 (Ex 'e')

• Mechanical installation:

It is essential to read the information sheet "Important instructions when using sight glass fittings" before commencing installation work.

The Ex camera is attached to the cover flange of a circular sight glass fitting or flow sight glass or to the slotted cover nut of a screw-type sight glass using the mounting components provided.

On no account should the lens of the camera be exposed to direct sunlight as this will render it inoperable!

The VISULEX Ex-Camera K06A-Ex fits the following nominal diameters when used together with the appropriate mounting parts:

Type of fitting	from DN	Hinged bracket	Flanged adapter collar
Circular sight glass fitting DIN 28120 + DIN 28121	50	+	-
Flow indicator sight glasses	50	+	-
Screw-type sight glass fitting in line with DIN 11851	65	-	+
	80	+	+
	100	+	+
	125	+	-

• Mounting with hinged bracket:

The hinged bracket is intended for fastening the camera to the cover flange of a circular sight glass fitting or flow sight glass or to the slotted cover nut on screw-type sight glass fittings acc. to DIN 11851.

The hinged bracket is secured to the required bolt circle using the M8 screw included in the scope of supply which fits into a previously tapped blind hole. Alternatively, the hinged bracket can be welded in place.

• Mounting by flanged adapter collar

The adapter collar is secured to the slotted cover nut (DIN 11851) by welding or screwing it on.

• Replacement parts:

Product	Part No.
Screw-type sight glass	1774.079.00
O-ring seal	0862.039.00

• Accessories:

Product	Part No.
Camera mounting straight	0354.005.00
Camera mounting (flanged adapter)	1356.015.00
Claw spanner for screw-type sight glass, for opening the camera	6805.001.00

• Maintenance:

- Keep the camera clean.
- After opening the camera, the thread of the screw-type glass lens (part 4) should be freshly greased, (e.g. with AEMA-SOL 6 B, made by A.E. Matthes).
- Clean the glass disc regularly to ensure optimum camera vision.
- Always use original replacement parts.